


DOS CURVE

Mount Instructions Installation ou de montage

WARNING: Disconnect main power at the source prior to installation! Fixture must be installed by a qualified electrician.

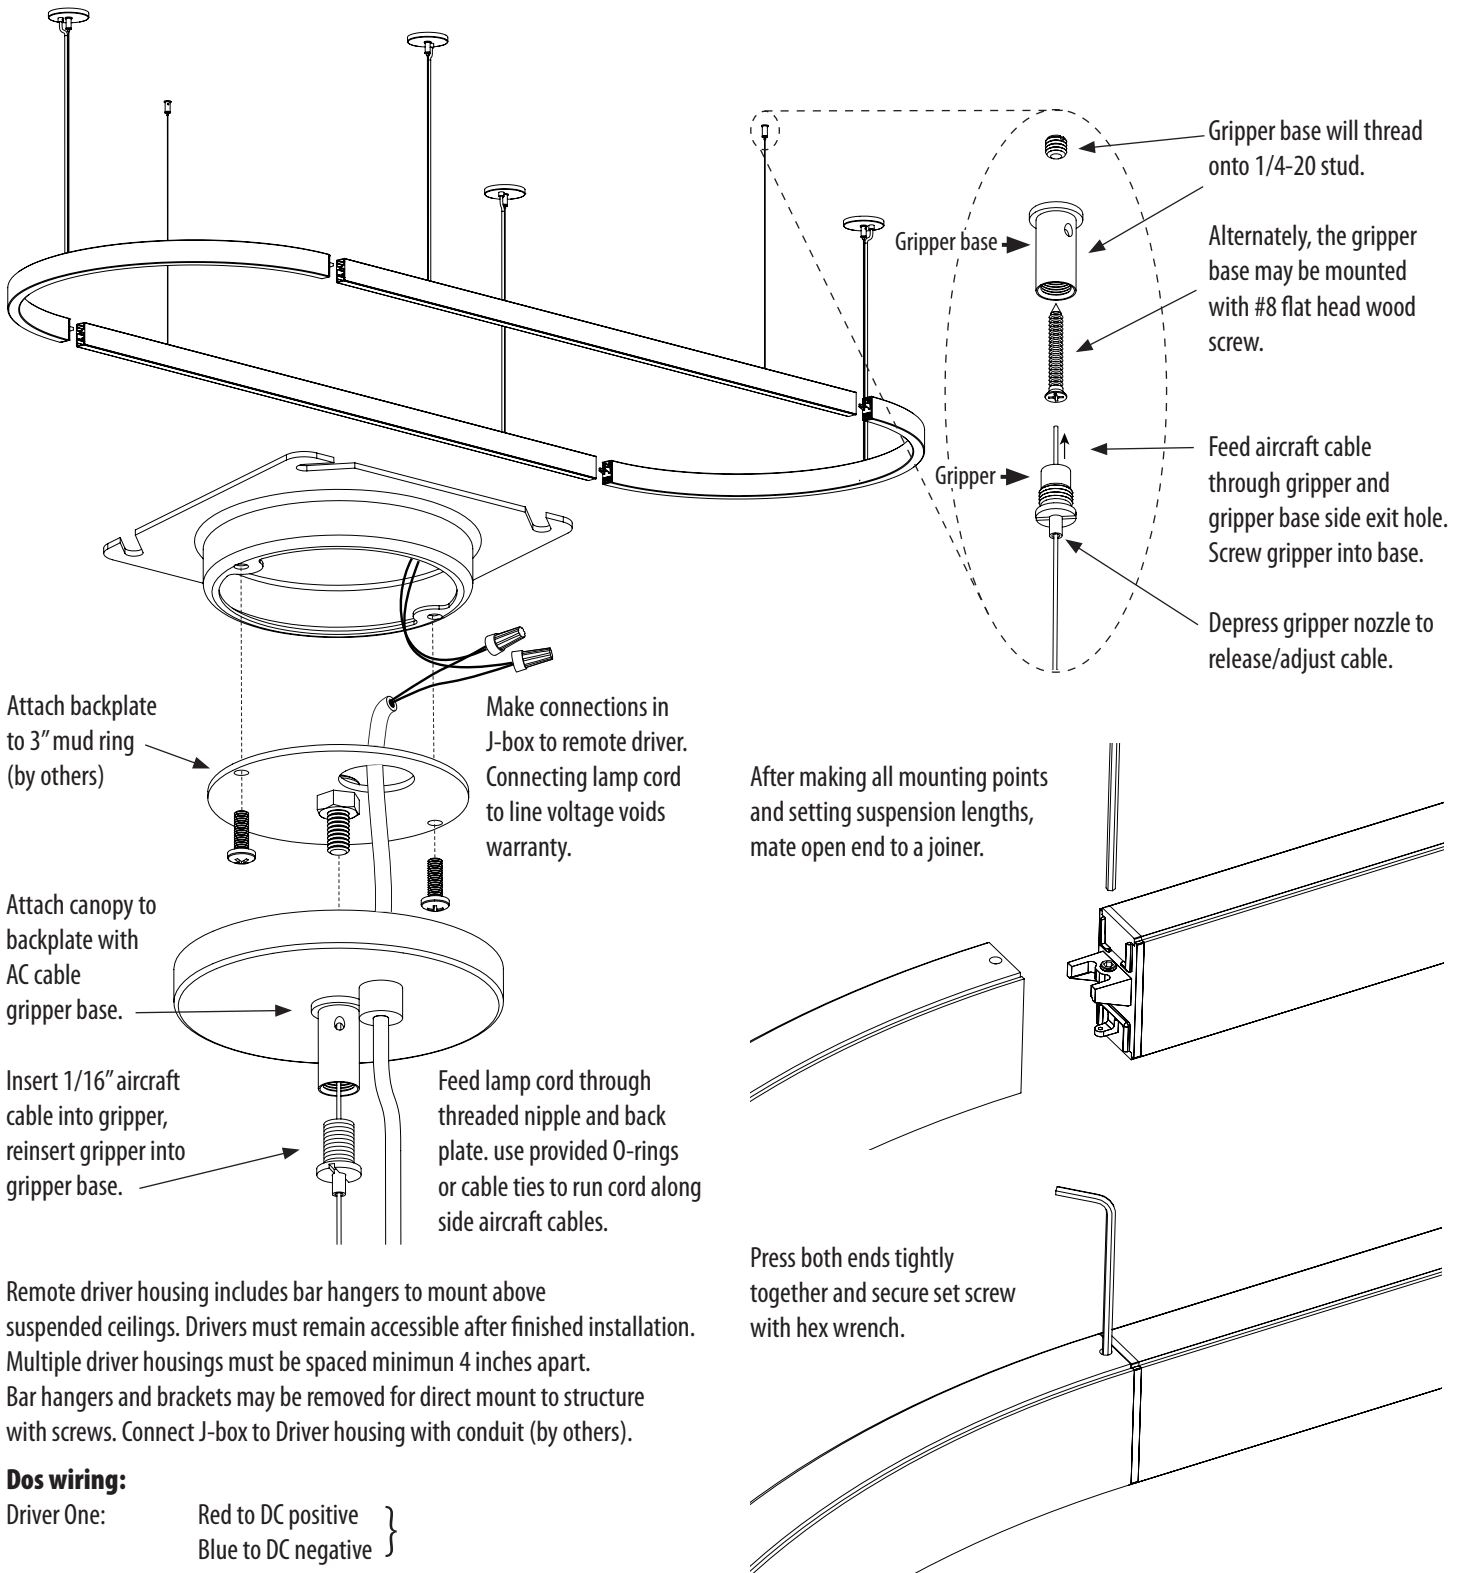

Remote driver housing includes bar hangers to mount above suspended ceilings. Drivers must remain accessible after finished installation. Multiple driver housings must be spaced minimum 4 inches apart. Bar hangers and brackets may be removed for direct mount to structure with screws. Connect J-box to Driver housing with conduit (by others).

Dos wiring:

Driver One: Red to DC positive }
 Blue to DC negative }

Driver Two: Red/White to DC positive }
 Blue/White to DC negative }

Dimming:

Purple and Gray wires from driver to 0-10V dimmer. Cap if unused.